


**ALL CLIENTS INFOREMATON HAS BEEN REMOVED FROM THIS DRAWING.**

FCU SCHEDULE FOR HV & LV ROOMS							
IDENTIFICATION	MAKE	MODEL	TYPE	NOMINAL COOLING (kW)	NOMINAL HEATING (kW)	AIR VOLUME(L/s)@ LOW-HIGH SPEED SETTING	RUNNING CURRENT (A) HEATING / COOLING
FCU-10-LV Room	MITSUBISHI	PKAM71KA2	HIGH WALL MOUNTED	9.5	11.2	433-433	Fed by Outside Unit
FCU-11-HV Room	MITSUBISHI	PKAM71KA2	HIGH WALL MOUNTED	9.5	11.2	433-433	Fed by Outside Unit

FCU SCHEDULE FOR LV ROOM & MAIL HALL							
IDENTIFICATION	MAKE	MODEL	TYPE	NOMINAL COOLING (kW)	NOMINAL HEATING (kW)	STARTING CURRENT (A)	RUNNING CURRENT (A) HEATING / COOLING
FCU-10-LV Room	MITSUBISHI	PUZ-ZM71VHA2	CONDENSER	8.0	7.1	13.46	7.96
FCU-11-HV Room	MITSUBISHI	PUZ-ZM71VHA2	CONDENSER	8.0	7.1	13.46	7.96

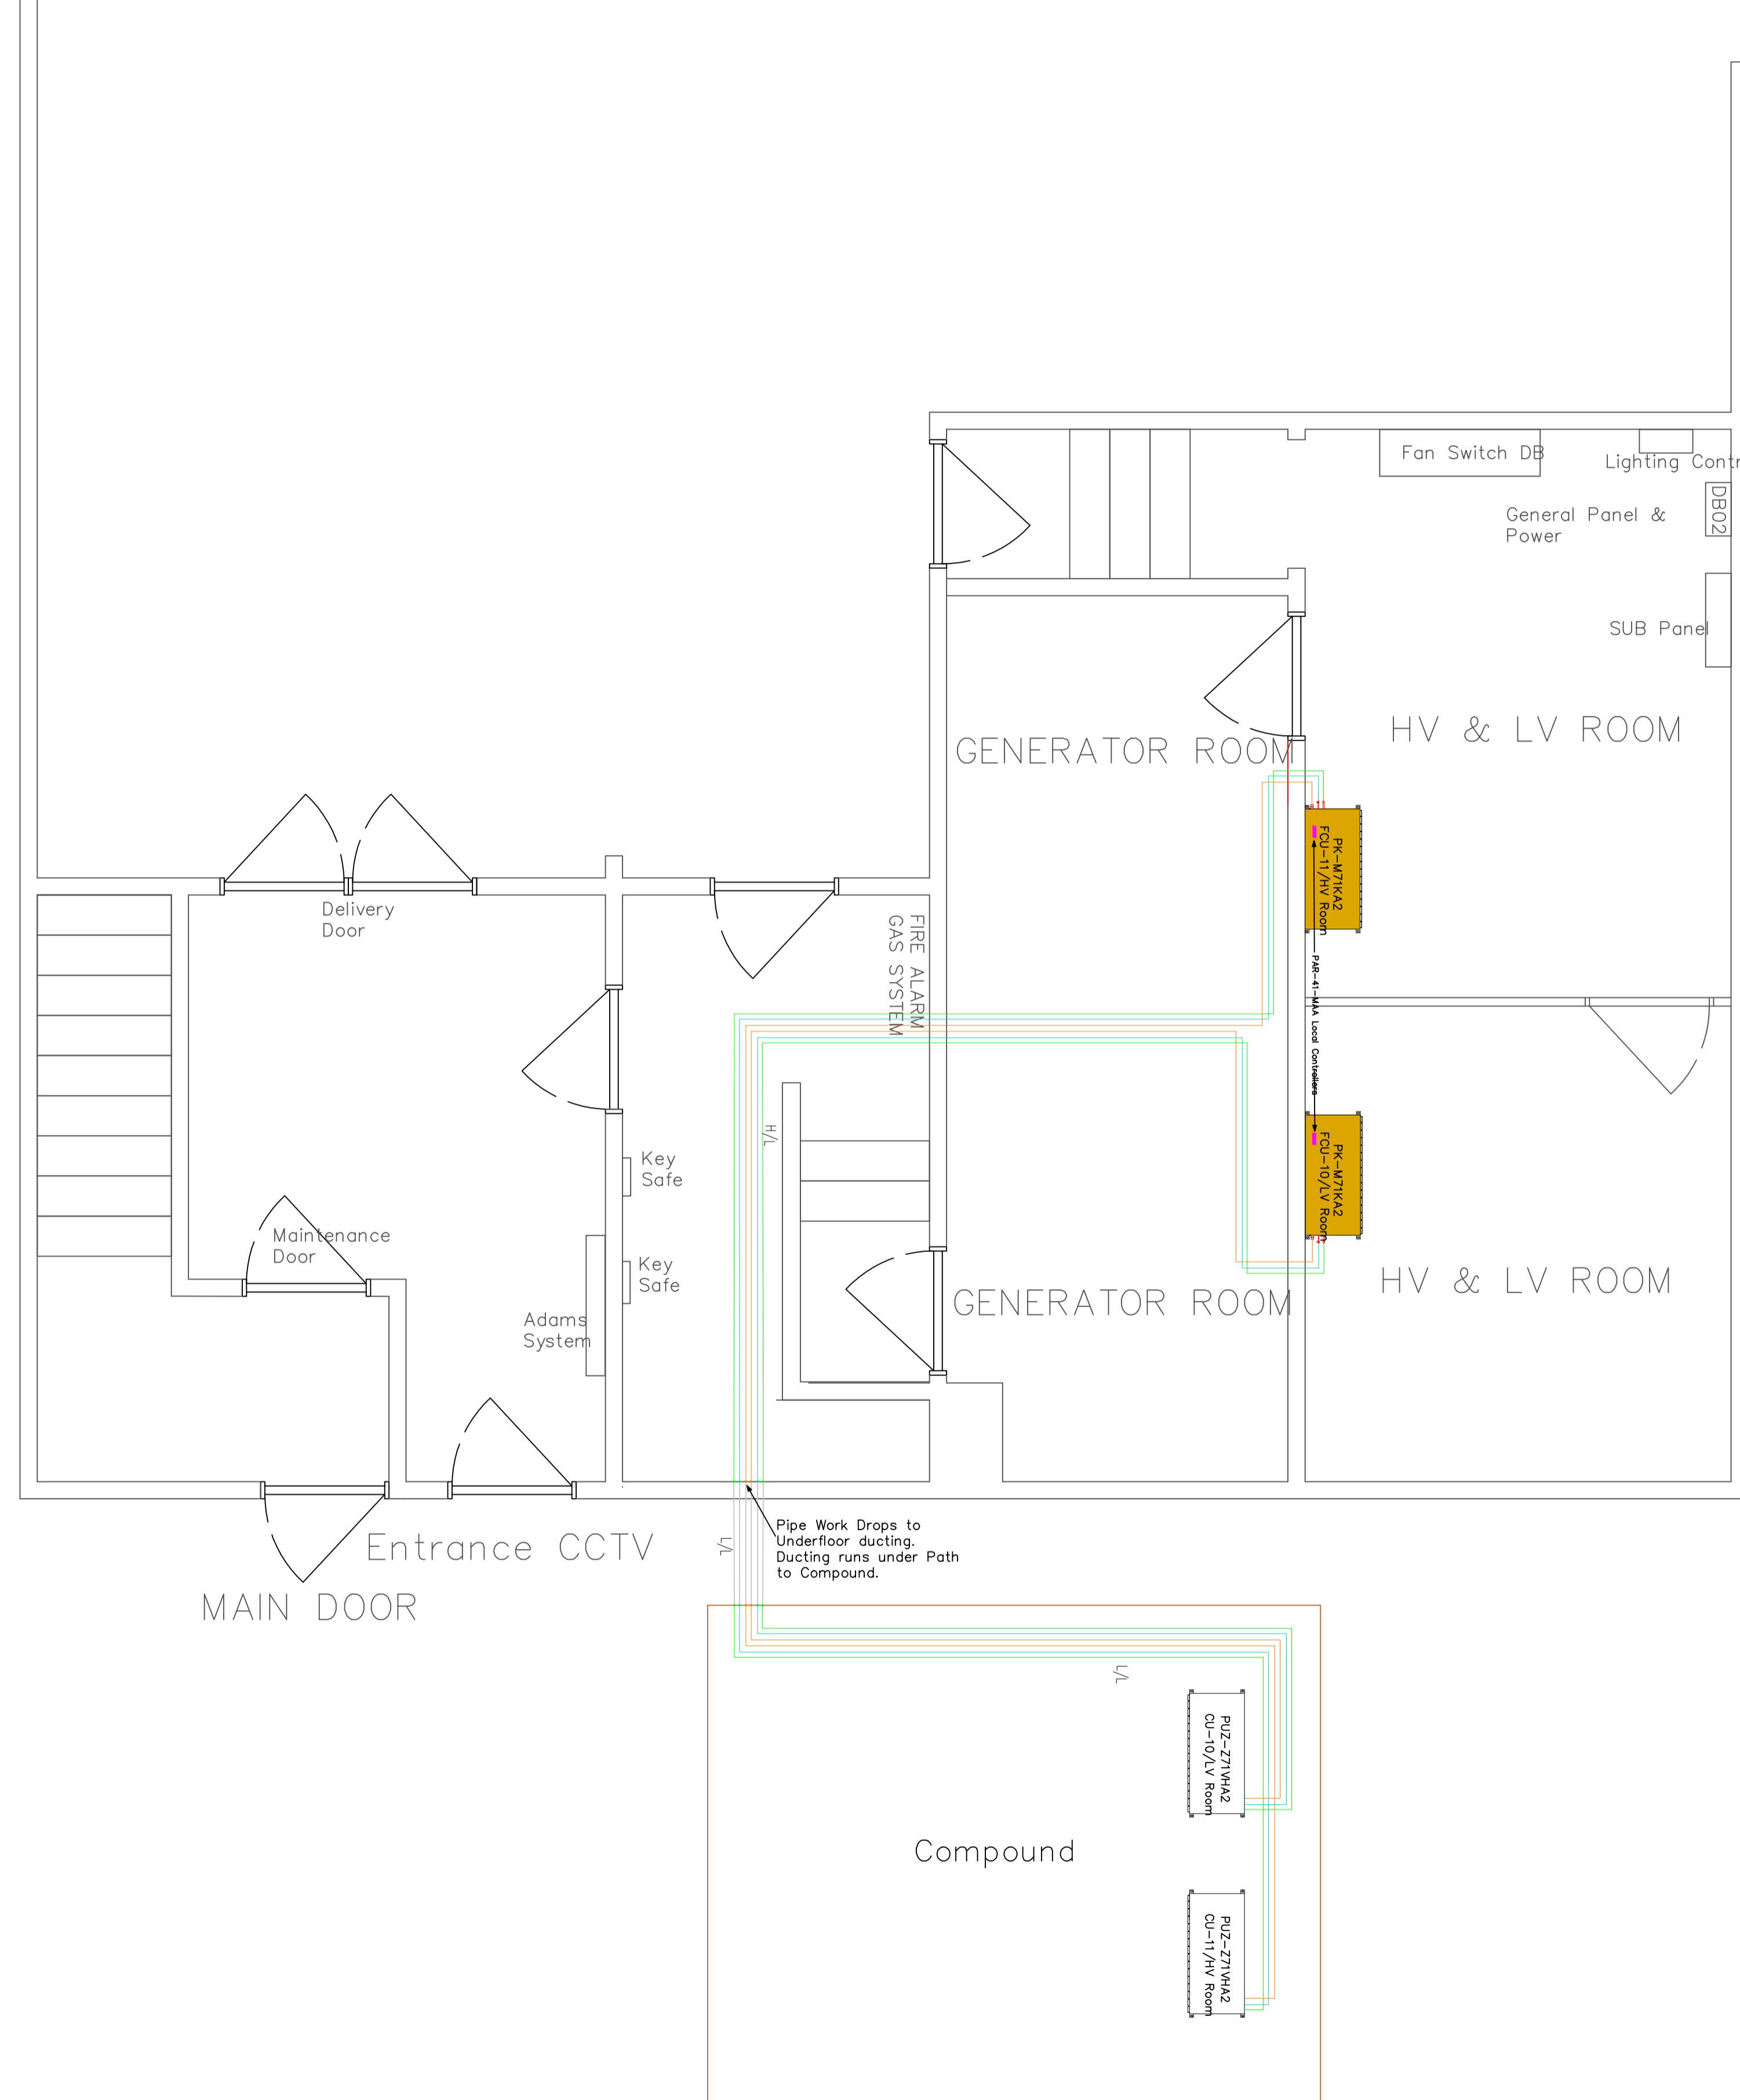

REV	DESCRIPTION	DATE
1/A	ISSUED FOR APPROVAL	-
	REVISIONS	

STATUS  
**ISSUED FOR APPROVAL**



CLIENT	-
PROJECT	-
TITLE	-
SCALE	DESIGNED
CONTRACT NUMBER	DRAWN
DATE	CHECKED
DRAWING NUMBER	REVISION
	-