

ALL CLIENTS INFOREMATION HAS BEEN REMOVED FROM THIS DRAWING.


GROUND FLOOR INDOOR FCU SCHEDULE (OR EQUAL & ENGINEER APPROVED)							
IDENTIFICATION	MAKE	MODEL	TYPE	NOMINAL COOLING (kW)	NOMINAL HEATING (kW)	AIR VOLUME (L/s) @ LOW-HIGH SPEED SETTING	RUNNING CURRENT (A) HEATING/COOLING
FCU-01	MISUBISHI	PEAD-M140JA	DUCTED FCU	13.6	16.0	533-767	FED BY OUTDOOR UNIT
FCU-02	MISUBISHI	PEAD-M140JA	DUCTED FCU	13.6	16.0	533-767	FED BY OUTDOOR UNIT
FCU-03	MISUBISHI	PEAD-M140JA	DUCTED FCU	13.6	16.0	533-767	FED BY OUTDOOR UNIT
FCU-04	MISUBISHI	PEAD-M140JA	DUCTED FCU	13.6	16.0	533-767	FED BY OUTDOOR UNIT

GROUND FLOOR OUTDOOR UNIT SCHEDULE (OR EQUAL & ENGINEER APPROVED)							
IDENTIFICATION	MAKE	MODEL	TYPE	NOMINAL COOLING (kW)	NOMINAL HEATING (kW)	STARTING CURRENT (A)	RUNNING CURRENT (A) HEATING/COOLING
CU-01	MITSUBISHI	PUZ-M140VKA-2	CONDENSER	13.6	16	13.2 AMP 1PH	6.42/5.71
CU-02	MITSUBISHI	PUZ-M140VKA-2	CONDENSER	13.6	16	13.2 AMP 1PH	6.42/5.71
CU-03	MITSUBISHI	PUZ-M140VKA-2	CONDENSER	13.6	16	13.2 AMP 1PH	6.42/5.71
CU-04	MITSUBISHI	PUZ-M140VKA-2	CONDENSER	13.6	16	13.2 AMP 1PH	6.42/5.71



LINDAB JET-D SUPPLY AIR NOZZLE

- LEGEND:
- REFRIGERANT PIPEWORK
  - CONDENSATE
  - SUPPLY VENTILATION
  - C MECHANICAL CONTROLLER
  - CC CENTRAL CONTROLLER - EA-200
  - [ LOCAL CONTROLLER - PAR-41MAA
  - O EYE BALL DIFFUSERS LINDAB JET-D

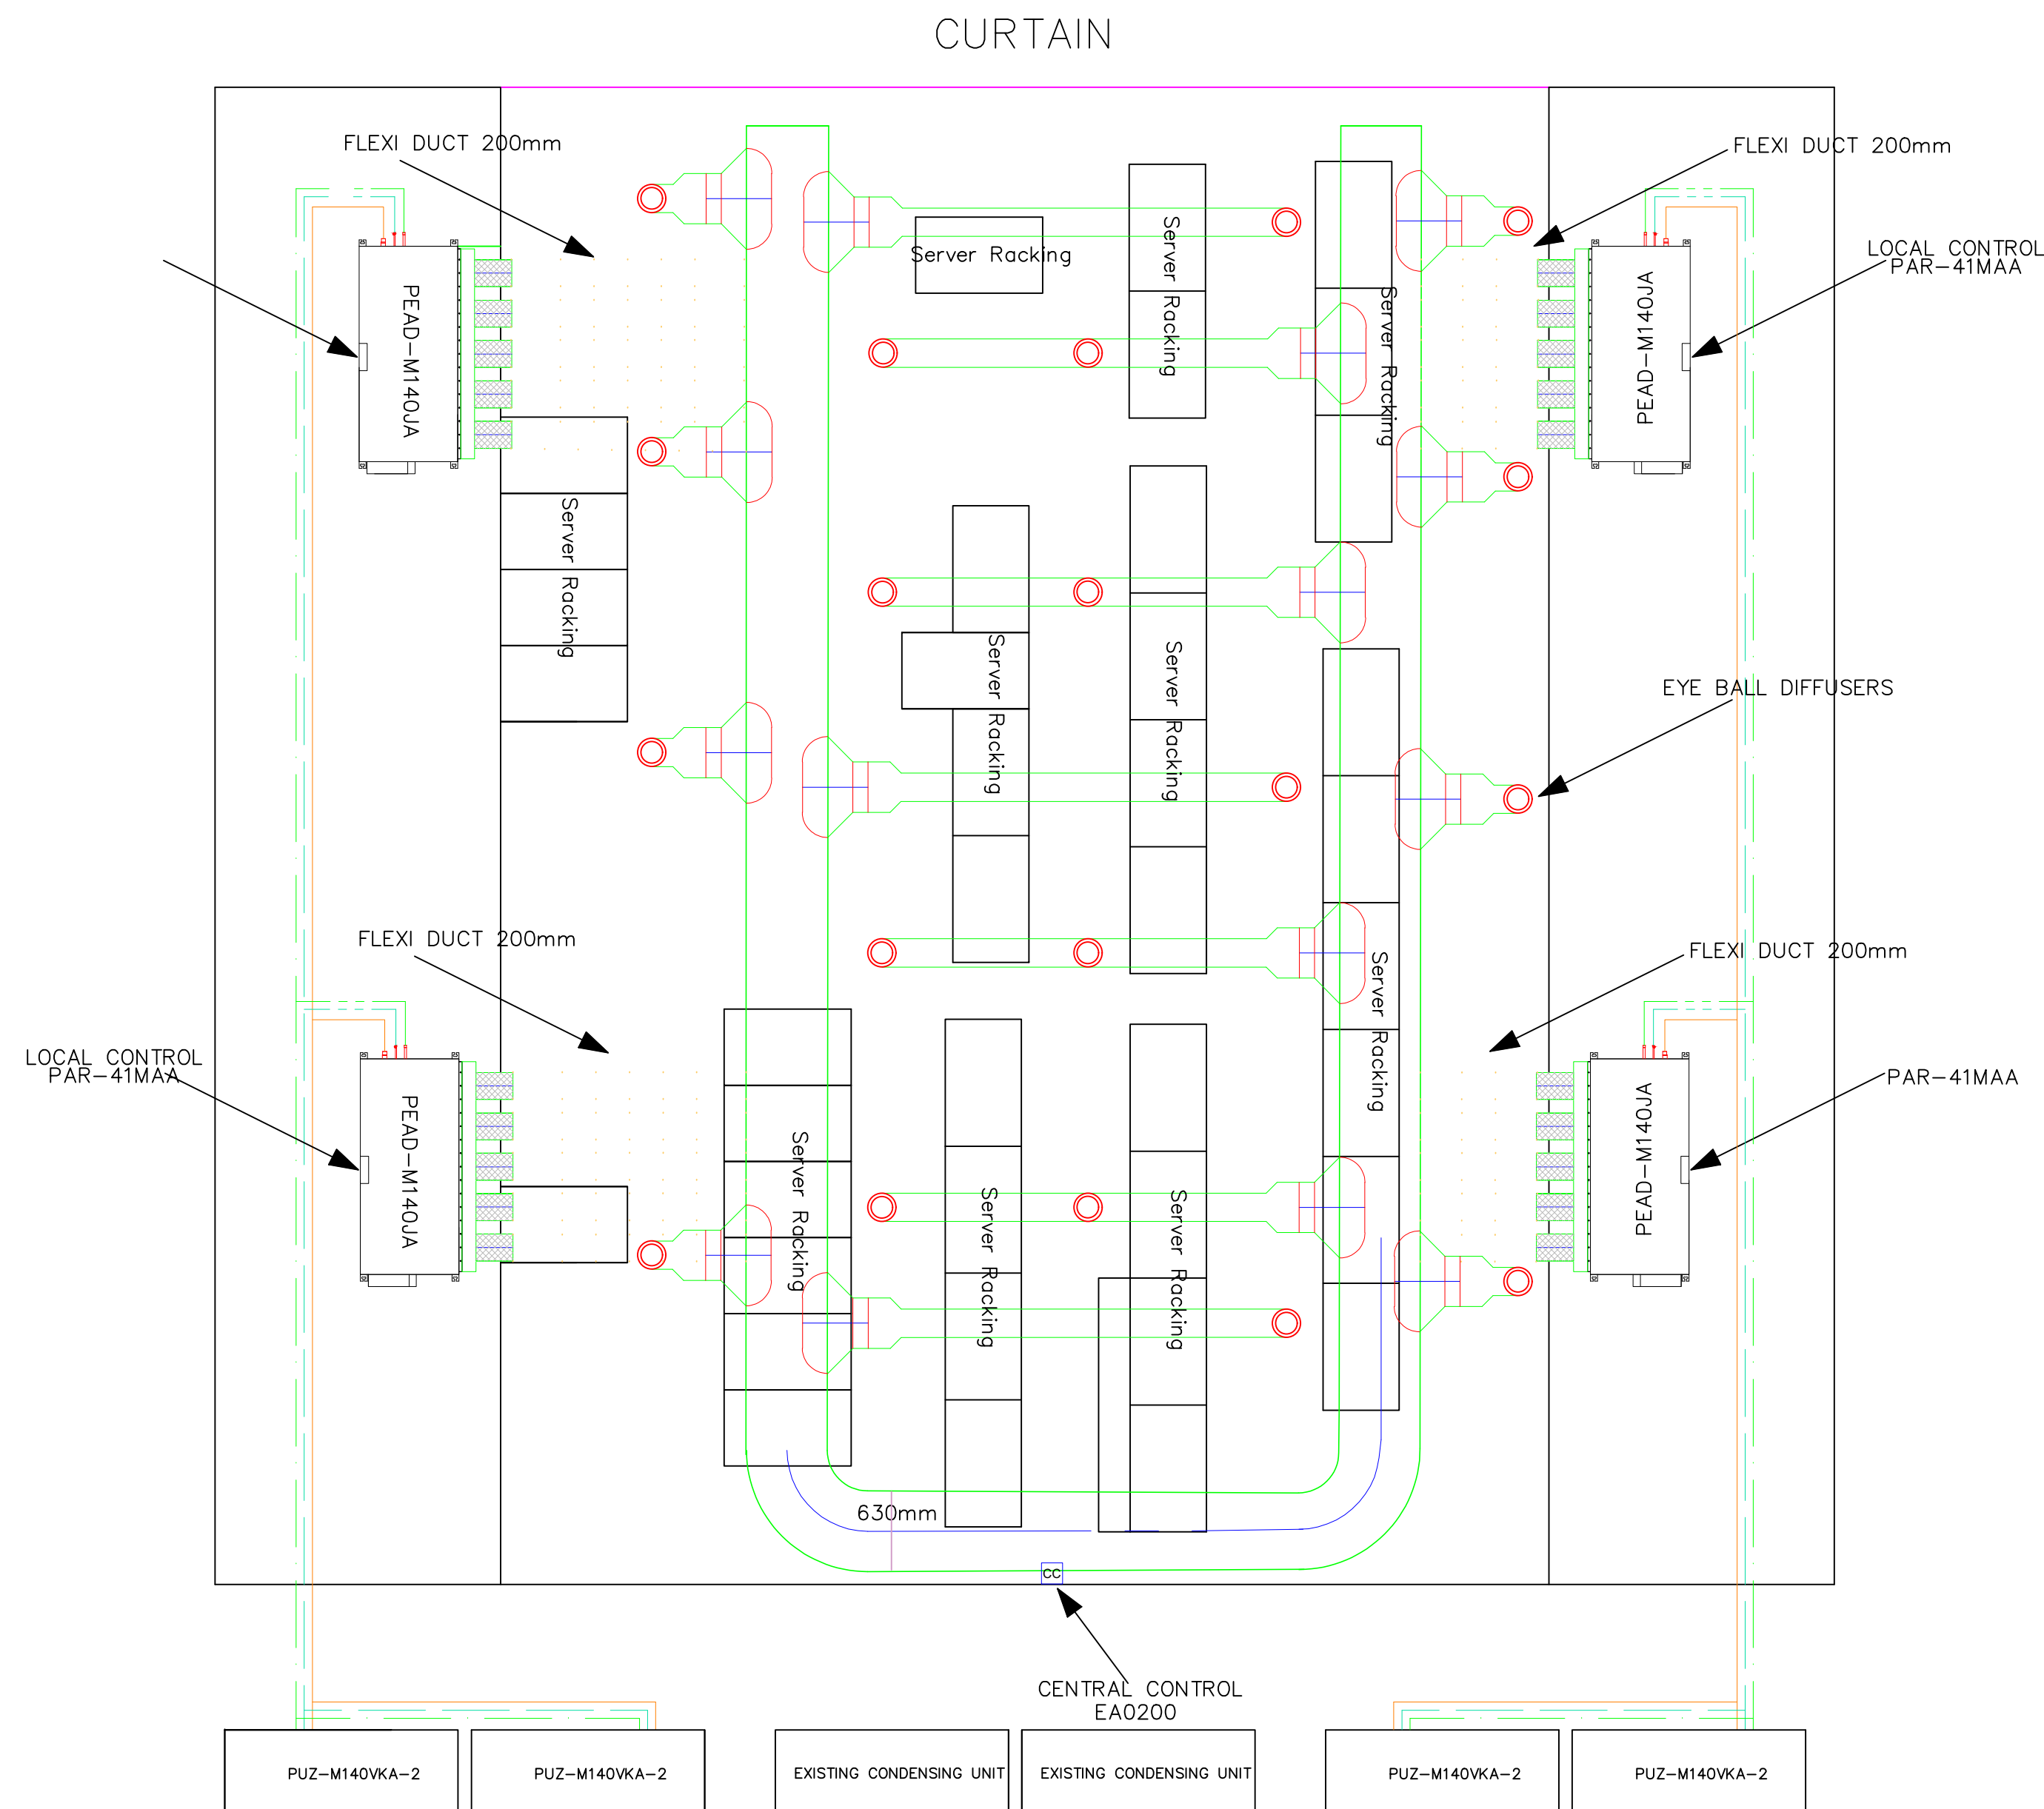

REV	DESCRIPTION	DATE
1/A	ISSUED FOR APPROVAL	-
	REVISIONS	

STATUS  
ISSUED FOR APPROVAL



CLIENT	-
PROJECT	-
TITLE	-
SCALE	DESIGNED
CONTRACT NUMBER	DRAWN
DATE	CHECKED
DRAWING NUMBER	REVISION
	-